
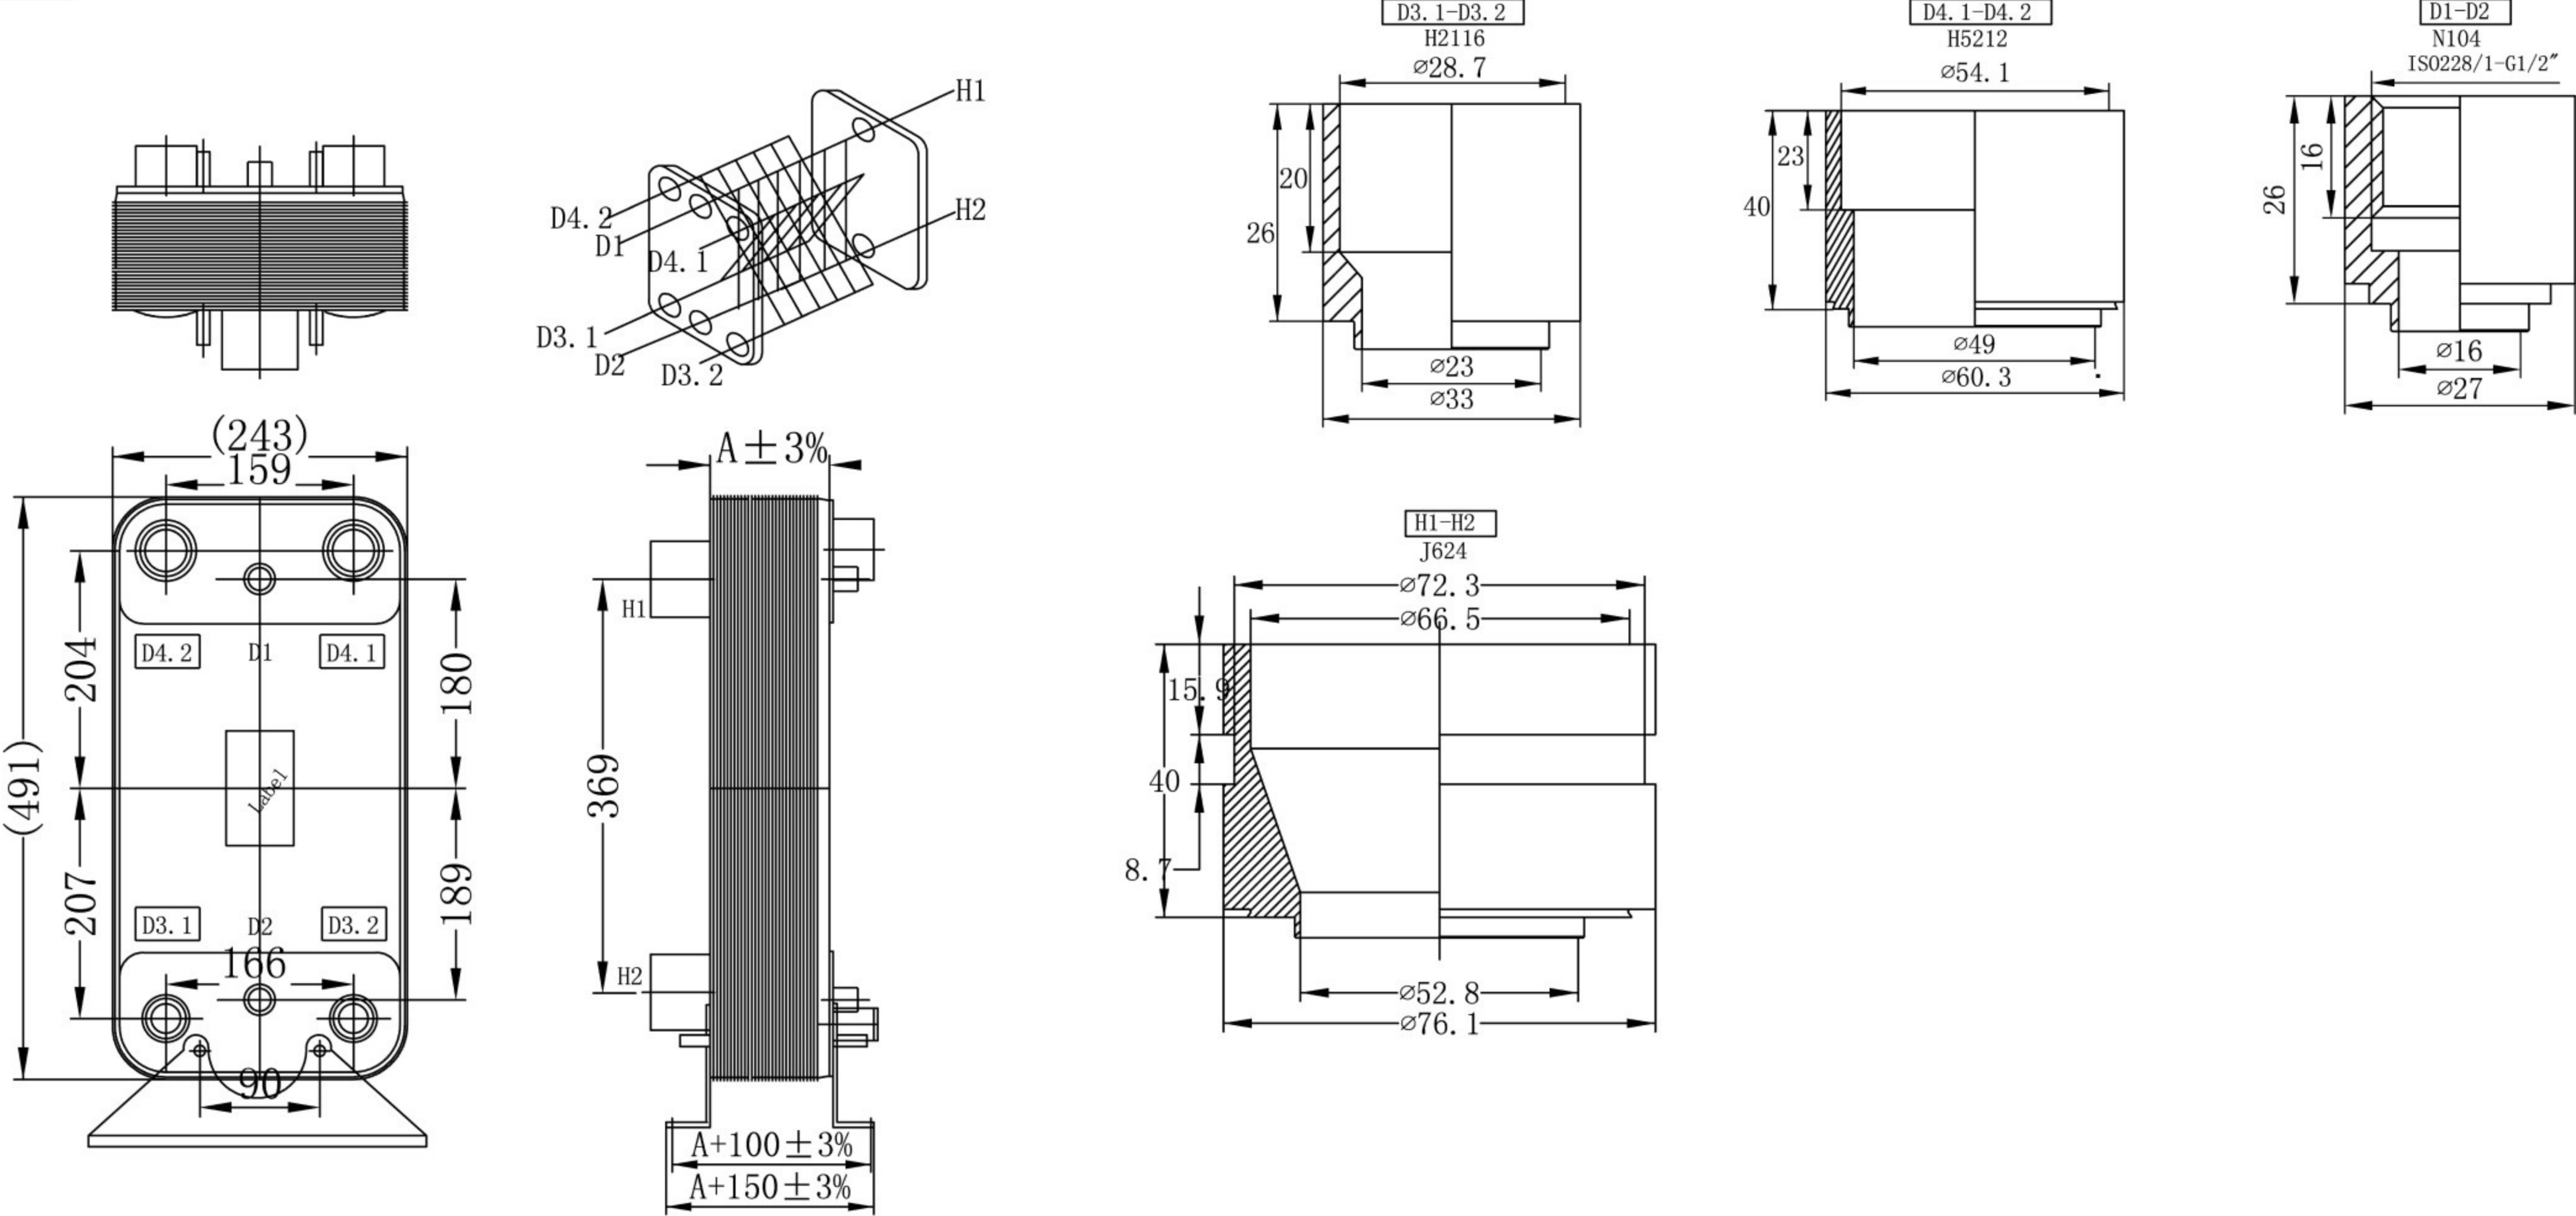




Item	Model	Description	A
1	HBL100DE-122	N104-D1-D2,H2116-D3.1-D3.2,H5212-D4.1-D4.2,J624-H1-H2	258
2	HBL100DE-142	N104-D1-D2,H2116-D3.1-D3.2,H5212-D4.1-D4.2,J624-H1-H2	298
3	HBL100DE-162	N104-D1-D2,H2116-D3.1-D3.2,H5212-D4.1-D4.2,J624-H1-H2	339
4	HBL100DE-182	N104-D1-D2,H2116-D3.1-D3.2,H5212-D4.1-D4.2,J624-H1-H2	379
5	HBL100DE-202	N104-D1-D2,H2116-D3.1-D3.2,H5212-D4.1-D4.2,J624-H1-H2	420
6	HBL100DE-222	N104-D1-D2,H2116-D3.1-D3.2,H5212-D4.1-D4.2,J624-H1-H2	461

备注：加底脚

		DESIGN DATA			
DESIGN PRESSURE		4.5MPa			
TEST PRESSURE		6.75MPa			
DESIGN TEMPERATURE		-196/+225			
LEAKAGE TEST		He检			
PLATE MATERIAL		316L			
PIPE MATERIAL		304			
FRAME MATERIAL		304			
Assembly drawing	DEPARTMENT	Sales Department	DATE	SCALE	 BAODE HEAT EXCHANGER 宝 得 换 热
	DESIGNER	JLN	2022/04/20		
	INSPECTOR	ZJF			MODEL HBL100EW
	APPROVAL	FL		DRAWING NO.	2305145

修改号	修改日期	修改内容	修改人员