
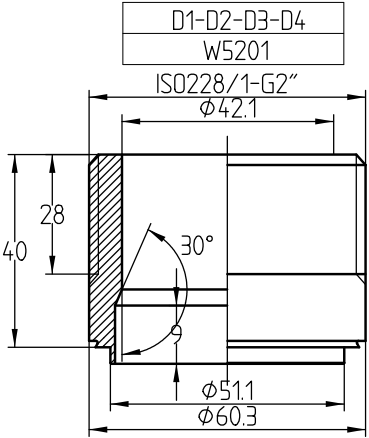


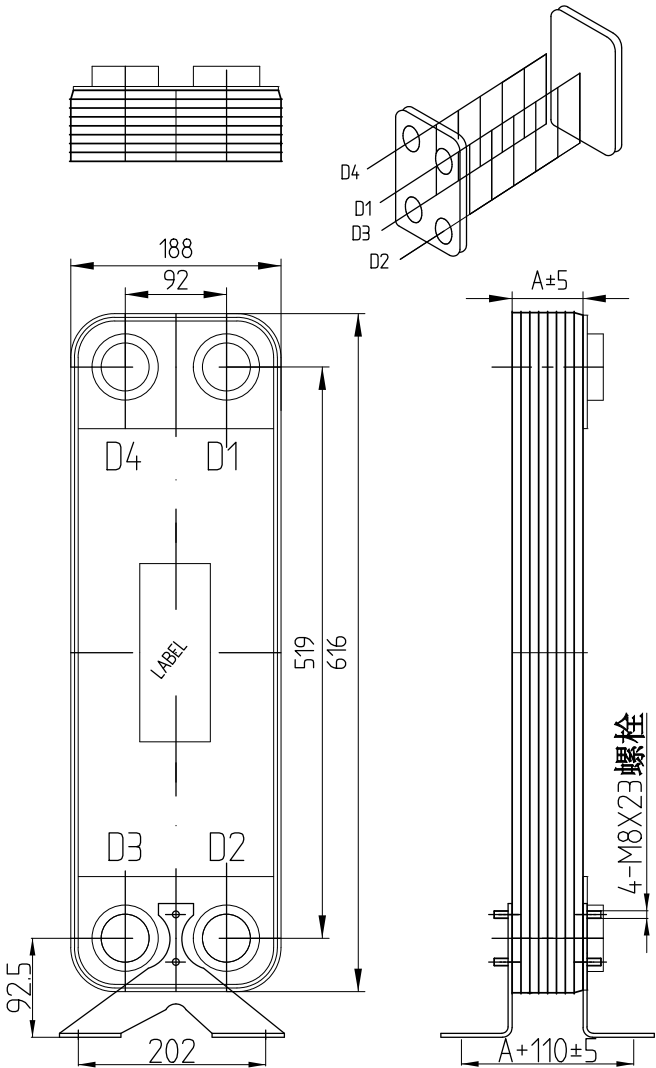

ID	Drawing No.	DESCRIPTION	A
1	2308248-01	HL95B-30D(W5201-D1-D2-D3-D4)	95
2	2308248-02	HL95B-40D(W5201-D1-D2-D3-D4)	123
3	2308248-03	HL95B-50D(W5201-D1-D2-D3-D4)	152
4	2308248-04	HL95B-60D(W5201-D1-D2-D3-D4)	180
5	2308248-05	HL95B-70D(W5201-D1-D2-D3-D4)	208
6	2308248-06	HL95B-80D(W5201-D1-D2-D3-D4)	236
7	2308248-07	HL95B-90D(W5201-D1-D2-D3-D4)	264

备注：加底脚

			DESIGN DATA			
DESIGN PRESSURE			4.5MPa			
TEST PRESSURE			6.75MPa			
DESIGN TEMPERATURE			-196/+225			
LEAKAGE TEST			He检			
PLATE MATERIAL			316L			
PIPE MATERIAL			304			
FRAME MATERIAL			304			
Assembly drawing	DEPARTMENT	Sales Department	DATE	SCALE	 BAODE HEAT EXCHANGER 宝 得 换 热	
	DESIGNER	JLN	2022/09/20			
	INSPECTOR	ZJF			MODEL	HBL95B
	APPROVAL	FL		DRAWING NO.	2308248	REV 0

修改号	修改日期	修改内容	修改人员
-----	------	------	------